



GENERAL NOTES:

1. ALL ABOVE GROUND PIPING SHALL BE PAINTED PANTONE PURPLE 522-C.
2. ALL ABOVE GROUND PIPES WILL BE FLANGED END. ALL HARDWARE NUTS AND BOLTS SHALL BE STAINLESS STEEL.
3. (4) VEHICULAR GUARD POSTS TO BE INSTALLED AROUND METER. CONFIGURATION TO BE ILLUSTRATED ON CONSTRUCTION DOCUMENTS SUBMITTED FOR REVIEW AND APPROVAL.
4. ALL PLANTING SHALL BE A MINIMUM OF 3' FROM EDGE OF SHALL SLAB AND PROVIDE A 3' ACCESS OPENING.
5. ALL PIPES UNDER 3" SHALL BE BRASS.
6. METER ASSEMBLY SHALL BE LOCATED WITHIN COUNTY UTILITY EASEMENT.
7. ALL BELOW GRADE GROUND CONNECTIONS TO BE VIA EXOTHERMIC WELD (CADWELD) UNLESS INDICATED OTHERWISE.

CONTROL/ELEMENTARY SYMBOLS

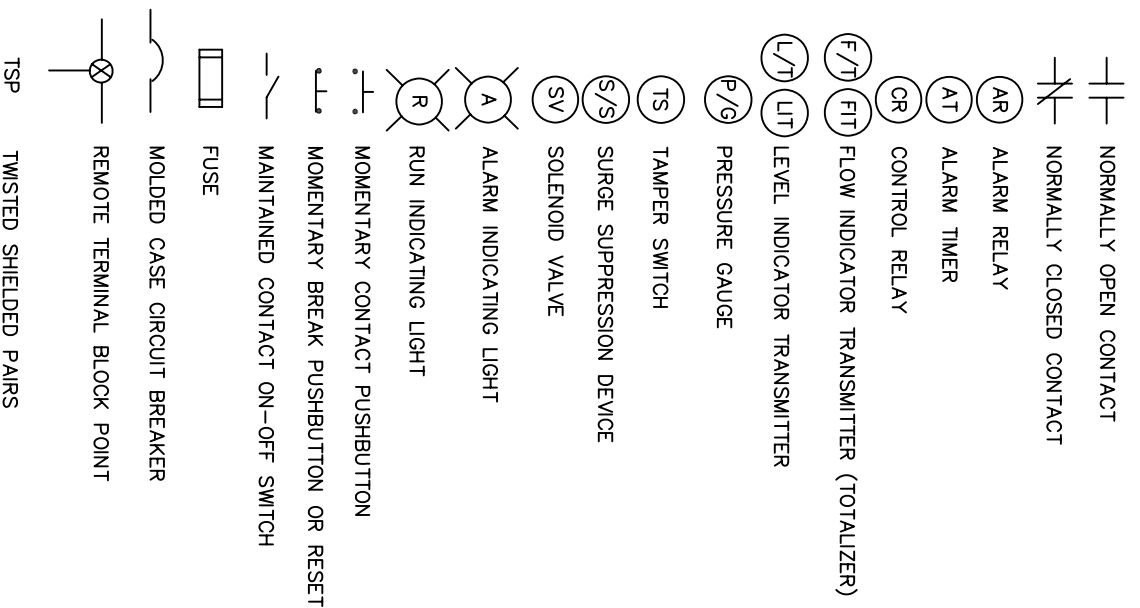

ELECTRICAL PLAN SYMBOLS

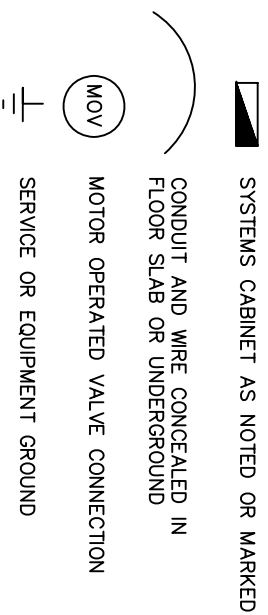

REVISED: APRIL 2006

ND - F1

REUSE SYSTEM STANDARD SERVICE CONNECTIONS  
OPEN/CLOSE VALVE SINGLE CONTROL PANEL SITE  
GENERAL NOTE AND KEYNOTES  
 NTS