


REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER ASSEMBLY (PROVIDED BY CONTRACTOR) SUPPLIED WITH AMMONIA AND CHLORINE RESISTANT SEATS AND SILICONE RUBBER SEALS. INSTALLATION AS REQUIRED BY COUNTY ORDINANCE AND AWWA M-14 STANDARDS (SEE APPROVED BACKFLOW DEVICES, APPENDIX G)

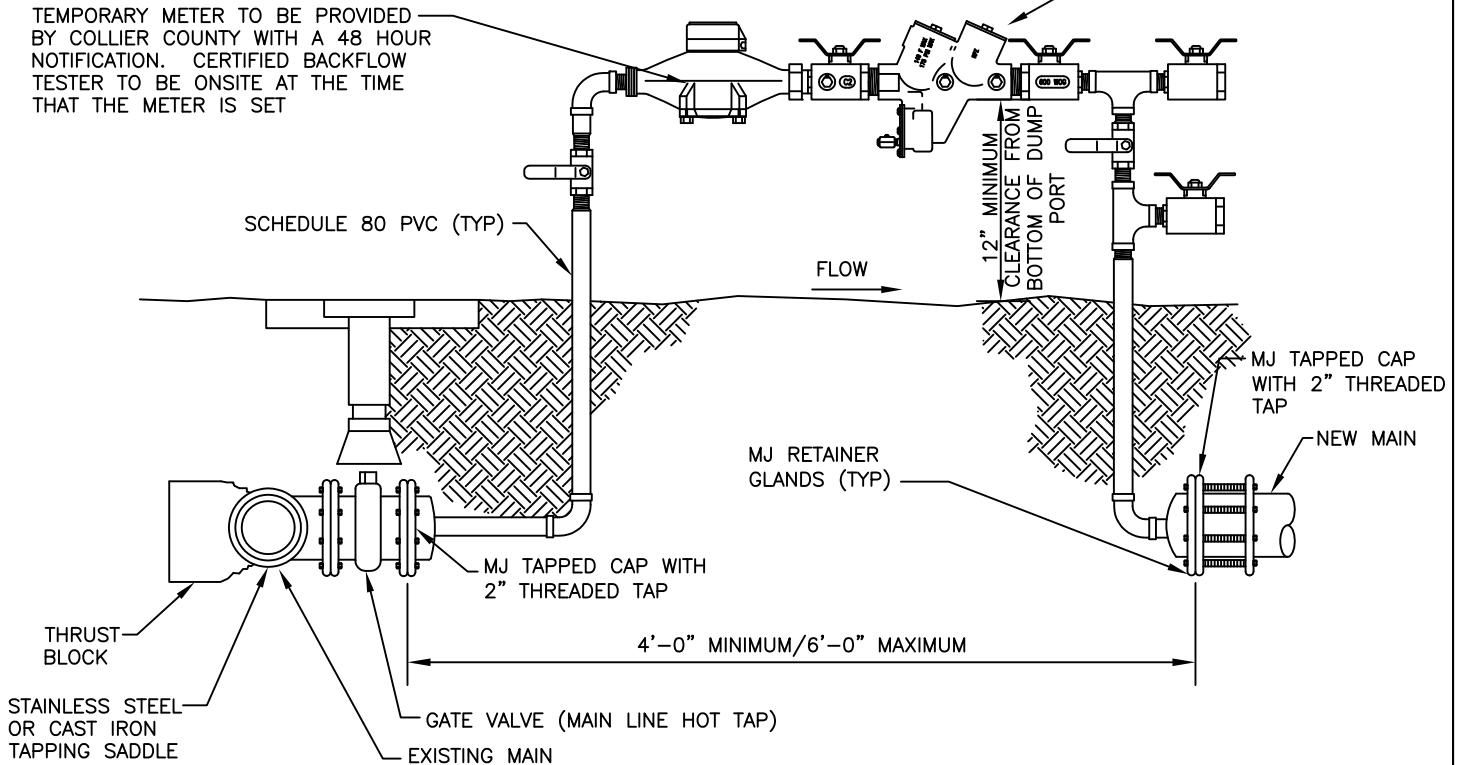

NOTES:

1. FINAL CONNECTION TO BE WITNESSED BY COLLIER COUNTY WATER DISTRIBUTION.
2. MJ TAPPED CAPS TO BE PROPERLY RESTRAINED.
3. INSTALL JUMPER TAP SYSTEM FOR TEMPORARY METER DOWNSTREAM OF BLIND FLANGE FOR CONSTRUCTION WATER.
4. TAPPING SADDLES MAY BE EITHER STAINLESS STEEL OR DUCTILE IRON. ALL TAPPING SADDLES FOR ASBESTOS CEMENT PIPE SHALL BE STAINLESS STEEL.
5. JUMPER ASSEMBLY MUST BE MINIMUM OF 18" ABOVE FINISHED GRADE.
6. BACKFLOW ASSEMBLY REQUIRES INITIAL CERTIFICATION BY CERTIFIED BACKFLOW TESTER.
7. THIS ASSEMBLY SHALL ONLY BE USED IF NO COMBUSTIBLES WILL BE ON SITE. IF COMBUSTIBLES ARE BROUGHT ON SITE, THEN THE TEMPORARY BACKFLOW PREVENTERS AND FIRE PROTECTION METER TIE-IN ASSEMBLY SHALL BE USED.
8. THIS ASSEMBLY IS NOT APPROVED TO PROVIDE FIRE PROTECTION WATER TO THE SITE DURING CONSTRUCTION. ASSEMBLY NOT TO BE REMOVED AND SPOOL PIECE INSTALLED FOR FINAL CONNECTION UNTIL AFTER TESTING, BACTERIAL CLEARANCE, FINAL INSPECTION AND COUNTY ACCEPTANCE.
9. GAP CONFIGURATION TO BE INSTALLED WITHIN 24 HOURS OR LESS AT THE DISCRETION OF THE WATER DISTRIBUTION DEPARTMENT.
10. ALL COMPONENTS THAT COME INTO CONTACT WITH DRINKING WATER SHALL CONFORM TO NSF STANDARD 61.
11. FOR INSTALLATIONS WHERE LESS THAN 20' OF NEW WATER MAIN IS BEING CONSTRUCTED BETWEEN THE PERMANENT BACKFLOW ASSEMBLY AND THE EXISTING MAIN, NO TEMPORARY JUMPER IS REQUIRED.

**CONNECTION TO EXISTING WATER MAIN
DETAIL
(GAP CONFIGURATION)**

NTS

JULY 2018



SHEET NO.
W-4